

CITY OF ENDERBY DRINKING WATER
SYSTEM

ANNUAL REPORT 2023

May 6, 2024

CONTENTS

Executive Summary.....	3
Introduction.....	4
Water System Overview	4
Annual Consumption Data.....	6
Drinking Water Cost Breakdown.....	7
Water System Assessment and Infrastructure Deficit	8
Completed Major Projects and Forthcoming Major Projects	8
Major Events.....	8
Water Quality Monitoring.....	9
Environmental Operators Certification.....	12
Water Conservation Plan.....	12
Cross Connection Control Program	13
Source Protection Plan.....	13
Emergency Response Plan.....	13

EXECUTIVE SUMMARY

The City of Enderby operates and maintains a community drinking water system in accordance with the Drinking Water Protection Act and the *Guidelines for Canadian Drinking Water Quality*.

In 2023, the total water distributed from the Water Treatment Plant was 556,568 m³. The maximum one-day demand was 2,943 m³ on July 22, 2023 . By contrast, in 2022, the total water distributed from the Water Treatment Plant was 529,280 m³ and the maximum one-day demand was on August 9, 2022 at 2,785 m³.

In 2023, the City of Enderby spent \$754,077 to operate and maintain the community drinking water system. Of that value, capital investment represents 20% of the total expended by the City of Enderby in 2023.

The City continues its water quality monitoring program. Nothing of concern was discovered in the drinking water system in 2023.

The City's Public Works staff is certified to meet the legislative requirements of operating the Water Treatment Plant and distribution system.

The City has completed its Source Protection Plan for both sources and has taken action to implement its short-term recommendations. The City also completed its annual update to its Drinking Water Emergency Response Plan.

INTRODUCTION

The City of Enderby operates and maintains a community drinking water system in accordance with the Drinking Water Protection Act and Regulations, as well as the *Guidelines for Canadian Drinking Water Quality*. Pursuant to Section 15(b) of the British Columbia Drinking Water Protection Act and Section 11 of the British Columbia Drinking Water Protection Regulation, the City of Enderby provides the following Annual Drinking Water Report for 2023.

The goal of the City of Enderby is to provide clean, safe, and reliable drinking water. This means that the drinking water quality meets the standards specified in the *Guidelines for Canadian Drinking Water Quality* and the operation of the drinking water system is consistent with the BC Drinking Water Protection Act and Drinking Water Protection Regulation.

High quality drinking water must meet requirements with respect to the following:

- Maximum acceptable concentrations of microbiological contaminants such as bacteria, protozoa, and viruses such as *Giardia*, *Cryptosporidium*, and *Escherichia coli*;
- Maximum acceptable levels of turbidity;
- Maximum acceptable chemical and physical parameters; and
- Aesthetic objectives related to taste, colour, and odour.

The City accomplishes these requirements through a multi-barrier approach to treatment. A multi-barrier approach is required as “the limitations or failure of one or more barriers may be compensated for by the effective operation of the remaining barriers. This compensation minimizes the likelihood of contaminants passing through the entire system and being present in sufficient amounts to cause illness to consumers.”¹

There are a variety of potential hazards to drinking water, most of which involve chemical and microbiological contaminants that may be introduced at the source or intake, during treatment, or during distribution. The City has implemented a water quality monitoring regime and uses multi-barrier treatment to manage the risks to public health. The City has a Drinking Water Emergency Response Plan and a Source Protection Plan for both of its sources.

WATER SYSTEM OVERVIEW

The Enderby water system consists of two sources:

Shuswap Well (ground water; suspected of being under the direct influence of surface water);
and
Shuswap River (surface water).

¹ Federal-Provincial-Territorial Committee on Drinking Water and the CCME Water Quality Task Group, “From Source to Tap: Guidance on the Multi-Barrier Approach to Safe Drinking Water” (Ottawa, Ontario: 2004), 17.

The total amount of pipe in the distribution system is 30,962 meters. There are booster stations by the Bawtree Bridge, at the bottom of Gunter-Ellison Road, and between the upper and lower reservoirs on Francis Drive.

All water is chlorinated prior to distribution. The Shuswap River surface water is filtered through a two-stage rapid filtration system which reduces turbidity and minimizes the threat of giardia and cryptosporidium. The Shuswap Well is normally piped to the Water Treatment Plant clearwell, where it receives ultraviolet treatment in addition to the chlorination received on-site.

Under normal operation, water from the Shuswap River is filtered and chlorinated, then pumped from the clearwell through the UV disinfection system and into the distribution system to a water reservoir. Water from the Shuswap Well is chlorinated on-site and pumped to the clearwell, then through the UV disinfection system and to the reservoirs. There is a total of 3,782 m³ of reservoir capacity. Each system can be isolated and run to the reservoirs alone.

It should be noted that, when the Shuswap Well is supplying water, a number of customers east of the Bawtree Bridge may receive water that is only disinfected with chlorine, meaning that it does not receive the two forms of treatment required for surface water (the Shuswap Well is suspected of being under the influence of surface water). However, when the supply of water is from the Water Treatment Plant, all customers receive fully treated water.

Under current operating parameters, the combined source capacity of the Shuswap River and the Shuswap Well is 4,753 m³ per day. The maximum production capacity of the Water Treatment Plant is 3,150 m³ per day under normal operating conditions at peak demand, although the rate of production is affected by source water turbidity, which increases backwashing frequency and reduces available production time. The ultimate planned source capacity, with expanded infrastructure, operational changes, and assuming the capability to run the Shuswap Well for twenty-four hours per day, is 6,135 m³.

ANNUAL CONSUMPTION DATA

Note: the below figures only describe the Water Treatment Plant flow meter; this does not reflect the full quantity of water sent from the Shuswap Well, some of which is distributed to residents east of the Bawtree Bridge without being captured by the flow meter.

In 2023, the total water distributed from the Water Treatment Plant was 556,568 m³. The maximum one-day demand was 2,943 m³ on July 22, 2023 . By contrast, in 2022, the total water distributed from the Water Treatment Plant was 529,280 m³ and the maximum one-day demand was on August 9, 2022 at 2,785 m³.


The following chart shows maximum and average daily demands from the Water Treatment Plant by month for 2022 and 2023.

Month	2023 Max. Daily Demand (m ³)	2023 Avg. Daily Demand (m ³)	2022 Max. Daily Demand (m ³)	2022 Avg. Daily Demand (m ³)
January	1635	1331	1535	1300
February	1403	1222	1368	1204
March	1352	1134	1248	1109
April	1282	1062	1296	1106
May	2258	1615	1608	1236
June	2573	1961	1901	1429
July	2943	2441	2776	2085
August	2935	2364	2785	2446
September	1909	1455	2628	1806
October	1307	1157	1483	1203
November	1296	1175	1365	1177
December	1562	1336	1669	1267

Year-to-year variations in demand tend to be influenced by the impact of weather upon consumption habits, particularly irrigation, while longer-range trends are influenced by the population growth rate offset by demand management initiatives such as water rates.

DRINKING WATER COST BREAKDOWN

In 2023, the City of Enderby spent \$754,077 to operate and maintain the community drinking water system. Of that value, capital investment represents 20% of the total expended by the City of Enderby in 2023.

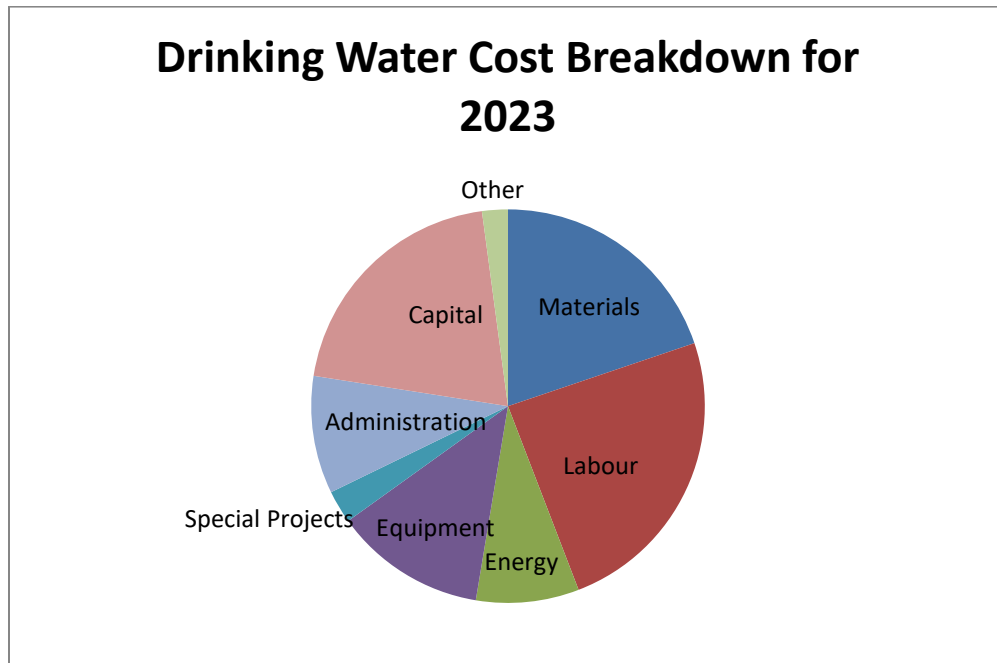

The following chart describes the dollar value associated with each expense category and compares the values to 2023:

Category	2023 Value	2022 Value
Materials	149,382	122,493
Labour	183,609	180,416
Energy	63,794	58,296
Equipment	94,035	65,813
Special Projects	20,425	68,079
Interest	-	-
Administration	72,908	69,301
Capital	153,951	216,485
Other	15,974	14,125

Total

754,077

795,005

WATER SYSTEM ASSESSMENT AND INFRASTRUCTURE DEFICIT

The total replacement value for the water distribution system (such as pipes and pumps) is \$28,900,107. As of December 31, 2023, the total depreciation is \$13,525,996

The total replacement value for the City of Enderby water treatment system (such as buildings, clarifier, chlorinators, and ultraviolet bank) is \$7,833,763. As of December 31, 2023, the total depreciation is \$4,269,858

In 2023, \$264,205 was contributed to the City of Enderby water reserve fund and \$48,800 was withdrawn, for a balance at the end of the year of \$705,024.

In order to address its infrastructure deficit, the City has committed to an incremental tax increase of 1% per year to the water utility. This amount is dedicated to asset management. The anticipated 2024 contribution to water reserves is \$272,100.

COMPLETED MAJOR PROJECTS AND FORTHCOMING MAJOR PROJECTS

There was a number of major water projects completed or forthcoming as of December 31, 2023:

- Peacher Crescent water main and service renewal (completed).
- Planning for Water Treatment Plant expansion (in progress).
- Reservoir #1 bypass program testing (in progress).
- Reservoir #1 renewal (forthcoming).
- Russell Avenue water main and service renewal (forthcoming)

MAJOR EVENTS

There was one period of elevated turbidity greater than 10 NTU in the Shuswap River during 2023. This lasted between April 17 and May 25, 2023. This event is when the majority of the seasonal freshet occurred. During this event, the water treatment plant was used as backup, and the Shuswap Well was the primary source to supply potable water to consumers.

Freshet runoff led to a peak river elevation between May 25th and 28th. During this time, the river was elevated to a point where the Shuswap Well was inaccessible by vehicle. The well was monitored via SCADA and samples were taken at a nearby test port to ensure water potability.

There were five total breaks or major leaks identified during the year. They were addressed and handled promptly and no major service disruptions were experienced.

WATER QUALITY MONITORING

Daily samples are collected at the Shuswap Well and River and tested for pH, temperature, and turbidity. Daily samples are also collected at the Water Treatment Plant and tested for pH, temperature, turbidity, and colour. The clearwell is tested on a daily basis for pH, temperature, turbidity, colour, and free and total chlorine.

Weekly system checks and distribution samples are tested for chlorine residuals to ensure a minimum of 0.20 mg/L of free chlorine is found throughout the distribution system. Chlorine residuals were above the minimum threshold for all sample locations and dates.

At least once per month, samples are collected at 10 monitoring stations within the distribution system for microbiological testing. No E. Coli was detected at any of the sample points within the distribution system in 2023.

The filter backwash is sampled on a bi-monthly schedule for pH, conductivity, turbidity, total suspended solids, aluminum, and microbiology.

On a quarterly basis, trihalomethane (THM) samples are collected from the Brash PRV, Booster #1, and Valcain stations. THMs are by-products caused by the chemical reaction between chlorine and organic matter naturally present in water. High levels of THMs can have adverse health effects and, as a result, the *Guidelines for Canadian Drinking Water Quality* set a maximum acceptable concentration of 0.1 mg/L. All THM tests from the above sample stations reported below the maximum acceptable concentration, with concentrations never exceeding 0.0616 mg/L.

The Shuswap Well is tested monthly for nitrogen levels (including nitrates and nitrites) and microbiology. The Shuswap River is sampled monthly for microbiology. Both sources are sampled quarterly for total organic carbon.

The Shuswap River is sampled annually for comprehensive testing. The Shuswap Well is sampled every second year for comprehensive testing. The Shuswap River and the Shuswap Well were both tested in 2023.

The results are as follows.

Parameter	River	Well
Chloride	0.51	1.88
Fluoride	<0.10	<0.10
Nitrate (as N)	<0.010	0.243
Nitrite (as N)	<0.010	<0.010
Sulfate	6.2	6.4
EPHw10-19	<250	<250
EPHw19-32	<250	<250
LEPHw	<250	<250
HEPHw	<250	<250

Langelier Index	-1.5	-1.4
Hardness, Total (as CaCO3)	47.2	54.6
Solids, Total Dissolved (calc)	57.3	75.7
Temperature, at pH	22.4	22.3
Colour, True	<5.0	<5.0
Alkalinity, Total (as CaCO3)	50.4	69.3
Alkalinity, Phenolphthalein (as CaCO3)	<1.0	<1.0
Alkalinity, Bicarbonate (as CaCO3)	50.4	69.3
Alkalinity, Carbonate (as CaCO3)	<1.0	<1.0
Alkalinity, Hydroxide (as CaCO3)	<1.0	<1.0
Cyanide, Total	<0.0020	<0.0020
Turbidity	0.53	0.16
pH	7.09	7.09
Conductivity (EC)	100	122
Coliforms, Total (Q-Tray)	1200	<1
E. coli (Q-Tray)	36	<1
Acenaphthene	<0.050	<0.050
Acenaphthylene	<0.200	<0.200
Acridine	<0.050	<0.050
Anthracene	<0.010	<0.010
Benz(a)anthracene	<0.010	<0.010
Benzo(a)pyrene	<0.010	<0.010
Benzo(b+j)fluoranthene	<0.050	<0.050
Benzo(g,h,i)perylene	<0.050	<0.050
Benzo(k)fluoranthene	<0.050	<0.050
2-Chloronaphthalene	<0.100	<0.100
Chrysene	<0.050	<0.050
Dibenz(a,h)anthracene	<0.010	<0.010
Fluoranthene	<0.030	<0.030
Fluorene	<0.050	<0.050
Indeno(1,2,3-cd)pyrene	<0.050	<0.050
1-Methylnaphthalene	<0.100	<0.100
2-Methylnaphthalene	<0.100	<0.100
Naphthalene	<0.200	<0.200
Phenanthrene	<0.100	<0.100
Pyrene	<0.020	<0.020
Quinoline	<0.050	<0.050
Aluminum, total	0.0289	0.0079
Antimony, total	<0.00020	<0.00020
Arsenic, total	<0.00050	<0.00050
Barium, total	0.0114	0.0117
Boron, total	<0.0500	<0.0500
Cadmium, total	<0.000010	<0.000010
Calcium, total	15.8	17
Chromium, total	<0.00050	<0.00050
Cobalt, total	<0.00010	<0.00010
Copper, total	0.00355	0.00612
Iron, total	0.038	<0.010

Lead, total	0.00022	0.00059
Magnesium, total	1.84	2.9
Manganese, total	0.00379	<0.00020
Mercury, total	<0.000010	<0.000010
Molybdenum, total	0.0007	0.00128
Nickel, total	<0.00040	0.00047
Potassium, total	0.87	1.21
Selenium, total	<0.00050	<0.00050
Sodium, total	1.39	2.82
Strontium, total	0.073	0.0847
Uranium, total	0.00029	0.00026
Zinc, total	<0.0040	0.0059
Benzene	<0.5	<0.5
Bromodichloromethane	<1.0	<1.0
Bromoform	<1.0	<1.0
Carbon tetrachloride	<0.5	<0.5
Chlorobenzene	<1.0	<1.0
Chloroethane	<2.0	<2.0
Chloroform	<1.0	<1.0
Dibromochloromethane	<1.0	<1.0
1,2-Dibromoethane	<0.3	<0.3
Dibromomethane	<1.0	<1.0
1,2-Dichlorobenzene	<0.5	<0.5
1,3-Dichlorobenzene	<1.0	<1.0
1,4-Dichlorobenzene	<1.0	<1.0
1,1-Dichloroethane	<1.0	<1.0
1,2-Dichloroethane	<1.0	<1.0
1,1-Dichloroethylene	<1.0	<1.0
cis-1,2-Dichloroethylene	<1.0	<1.0
trans-1,2-Dichloroethylene	<1.0	<1.0
Dichloromethane	<3.0	<3.0
1,2-Dichloropropane	<1.0	<1.0
1,3-Dichloropropene (cis + trans)	<1.0	<1.0
Ethylbenzene	<1.0	<1.0
Methyl tert-butyl ether	<1.0	<1.0
Styrene	<1.0	<1.0
1,1,2,2-Tetrachloroethane	<0.5	<0.5
Tetrachloroethylene	<1.0	<1.0
Toluene	<1.0	<1.0
1,1,1-Trichloroethane	<1.0	<1.0
1,1,2-Trichloroethane	<1.0	<1.0
Trichloroethylene	<1.0	<1.0
Trichlorofluoromethane	<1.0	<1.0
Vinyl chloride	<1.0	<1.0
Xylenes (total)	<2.0	<2.0

ENVIRONMENTAL OPERATORS CERTIFICATION

Interior Health requires that the City has a Chief Operator certified at a level that matches the facility classification for Water Treatment and Water Distribution.

The Water Treatment Plant is a Class II facility. The Water Distribution system is a Class I facility.

During 2023, City of Enderby employed the following certified operators:

Name	Title	Water Treatment	Water Distribution
Damon Kipp	Systems Operator III	Level II	Level I
Ray Brown	Lead Hand	Level I	Level I

WATER CONSERVATION PLAN

The City of Enderby's Water Conservation Plan establishes strategies to reduce water demand throughout the community. Reducing water demand helps to protect the watershed, mitigate requirements for infrastructure expansion, and reduce operating and maintenance costs.

As of December 31, 2023, the City of Enderby has achieved a number of strategies within its Water Conservation Plan, including:

1. Education
 - a. Implementing a Water Conservation Education program.
 - b. Continuing compliance patrols and enforcement of irrigation regulations.
2. Metering and Rates
 - a. Adopted a rate structure which balances conservation and equity.
 - b. Amended the Building Inspection Bylaw to include requirements for water meters.
 - c. Amended policies and agreements for out-of-town service connections to require water meters.
 - d. Completed water meter installations on all residential, commercial, industrial and civic properties.

Loss Control

- e. Completed a Loss Control Program in 2012, which estimated the total Unaccounted for Water at 6.5% or 12.05 m³ per hour.
- f. Completed a Leak Detection Audit to identify and repair water leaks within municipal infrastructure.

Planning for the Future

- g. Developing infrastructure upgrade plans for both treatment and distribution, in order to pursue grant funding.

CROSS CONNECTION CONTROL PROGRAM

In 2003, Interior Health required all large water purveyors (City of Enderby included) to implement a cross connection control program as a condition of operating permit. The purpose of the program is to protect public health by ensuring that the drinking water provided by the City of Enderby is not contaminated due to a backflow incident.

The City adopted a Cross Connection Control Program in 2004 and began the program implementation with assessments of a number of commercial, industrial, institutional and agricultural customers in June, 2004. Under Enderby's program, owners were expected to implement the recommendations in a timely manner and were responsible for all costs associated with their backflow prevention systems.

For a number of reasons, including cost and internal capacity limitations, the Cross Connection Control Program has not been fully implemented. The City of Enderby intends to increase compliance with its Cross Connection Control program in 2024 and will follow a risk-based approach focusing on premises isolation.

SOURCE PROTECTION PLAN

In February 2017, the City completed its Source Protection Plan for both the surface water intake and the Shuswap Well. The Source Protection Plan characterized the sources, provided an inventory of potential contaminants and threats, characterized risks, and recommended various actions to mitigate risk. As a result of this plan, the City has completed analyses of both sources for herbicides, pesticides, and petroleum in order to characterize the source water better. The City has also reached out to relevant third parties to inform them of the locations of the City's drinking water sources and request that they notify the City in the event of an accident, spill, fire, or natural disaster. The City has also requested that the Regional District of North Okanagan refer development applications within the designated groundwater protection area.

EMERGENCY RESPONSE PLAN

The City of Enderby Drinking Water Emergency Response Plan was completed in 2013. The Emergency Response Plan includes provisions for public notification and response procedures for emergency situations, such as backflow incidents, broken water mains, chlorinator failure, source and/or reservoir contamination, and spills or vehicle accidents affecting the distribution system. It also provides an emergency contact directory.

The Emergency Response Plan was updated on April 5, 2024.